



HAL
open science

Optimal Design of a Stand-Alone Hybrid PV/Fuel Cell Power System for the City of Brest in France

Omar Hazem Mohammed, Yassine Amirat, Mohamed Benbouzid, Gilles Feld, Tianhao Tang, Adel Elbast

► **To cite this version:**

Omar Hazem Mohammed, Yassine Amirat, Mohamed Benbouzid, Gilles Feld, Tianhao Tang, et al.. Optimal Design of a Stand-Alone Hybrid PV/Fuel Cell Power System for the City of Brest in France. International Journal on Energy Conversion, 2014, 2 (1), pp.1-7. hal-01017409

HAL Id: hal-01017409

<https://hal.science/hal-01017409>

Submitted on 2 Jul 2014

HAL is a multi-disciplinary open access archive for the deposit and dissemination of scientific research documents, whether they are published or not. The documents may come from teaching and research institutions in France or abroad, or from public or private research centers.

L'archive ouverte pluridisciplinaire **HAL**, est destinée au dépôt et à la diffusion de documents scientifiques de niveau recherche, publiés ou non, émanant des établissements d'enseignement et de recherche français ou étrangers, des laboratoires publics ou privés.

Optimal Design of a Stand-Alone Hybrid PV/Fuel Cell Power System for the City of Brest in France

Omar Hazem Mohammed^{1,2}, Yassine Amirat², Mohamed Benbouzid¹, Gilles Feld², Tianhao Tang³ and Adel A. Elbaset⁴

Abstract – This paper deals with the optimal design of a stand-alone hybrid photovoltaic and fuel cell power system without battery storage to supply the electric load demand of the city of Brest, Western Brittany in France. The proposed optimal design study is focused on economical performances and is mainly based on the loss of the power supply probability concept. The hybrid power system optimal design is based on a simulation model developed using HOMER. In this context, a practical load demand profile of Brest city is used with real weather data. **Copyright** © 2014 Praise Worthy Prize S.r.l. - All rights reserved.

Keywords: Hybrid power system, renewable energy, photovoltaic, fuel cell, generation unit sizing, energy cost, HOMER.

Nomenclature

HOMER	=	Hybrid Optimization Model for Electric Renewables;
PV	=	Photovoltaic;
FC	=	Fuel Cell;
COE	=	cost of energy;
CC	=	Capital Costs;
NPC	=	Net Present Cost;
TNPC	=	Total Net Present Cost;
O&M	=	Operation & Maintenance;

I. Introduction

The city of Brest is located in a sheltered position not far from the western tip of the Breton peninsula, and the western extremity of metropolitan France (Fig. 1). Providing electricity to this region is becoming a challenging task. Indeed, its energy consumption depends on the “regional sidelines” by high-voltage transmission lines through high-distance with consequent high-line losses, especially during stalling winter peak. In order to tackle this constraint, the city of Brest is adopting some tracks such as reducing its own consumption using other alternative resources (i.e. waste incineration power plants), generating savings wherever it is possible, or reporting peak periods and encouraging consuming less during these periods. Despite these solutions, the consumption of the city of Brest is still increasing and reaches 5% every year: This yield to urge the use of renewable energies. To today the use of renewable sources in energy production is still small compared to non-renewable energy sources such as fuel fossil and nuclear energies (Fig. 2). So renewable energy sources must be increased by adopting a hybrid energy source schemes to increase the system reliability and security [1]. One of the most promising hybridization

approaches is the combination of PV panels to other resource. Indeed, this is a well-developed technology that can be used in a large scale [2-7]. In addition, battery storage could be needed [8-10]. When the energy storage capacity may be limited, the use of supercapacitors could be a viable solution [11-12]. Renewable energy sources do not provide a constant power, but their complementary combination provides more continuous electrical output and is often supported by storage devices such as batteries to increase the system reliability [13-14]. In case of the renewable sources are not able to cope with the load demand, they can be hybridized with traditional energy sources, such as diesel generators (for stand-alone applications) [15-20].

For control purposes, different strategies based on operating modes and combining technical-economic aspects are considered for the energy management of stand-alone hybrid power systems [1-2], [21].

For the city of Brest, it is proposed a hybrid power systems using PV generators hydrogen for energy storage purposes. In this case, the hydrogen is produced by an electrolyzer powered by the electrical energy excess from the renewable energy source. The produced hydrogen feeds then a FC system, which will supply the city of Brest in high-load demand period. Otherwise, it will be used as a secondary source of energy [18-19]. For such kind of hybrid power systems, the sources can be optimally sized with different techniques and then selected from commercially available components [1], [22-23].

In this context, the proposed hybrid power system intended to provide electricity for the city of Brest is optimally designed using a HOMER-based study using a practical load demand profile of Brest city is used with real weather data.

The proposed hybrid power system model, which will be implemented in HOMER, is depicted by Fig. 3.

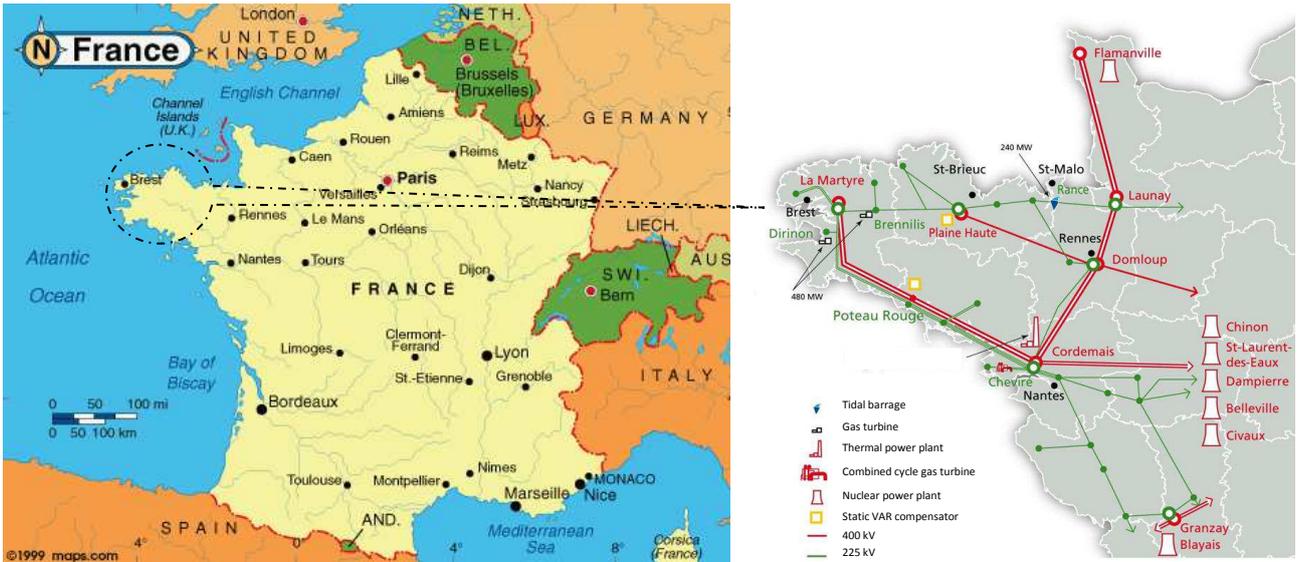


Fig. 1. City of Brest and Breton peninsula power grid.

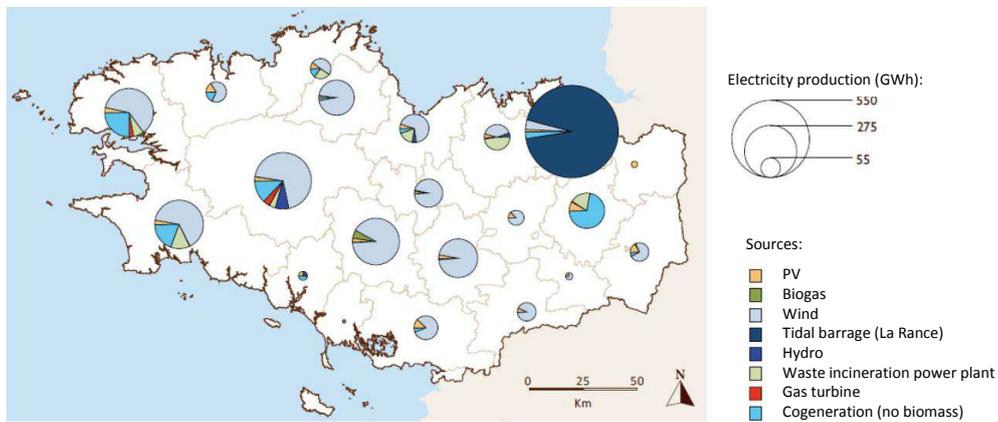


Fig. 2. Electricity production in the Breton peninsula.

II. Homer Software

The HOMER software has been developed by the National Renewable Energy Laboratory (NREL) [24]. It performs hourly simulations of every possible combination of components entered and ranks the systems according to user-specified criteria such as cost of energy (COE) or Capital Costs (CC). HOMER has been extensively used as a sizing and optimization software tool [25].

In this study, where the hybrid power system consists of PV generators, fuel cells, electrolyzer, and a hydrogen tank, HOMER will determine the best feasible power system configuration that can cope with the load demand. The analysis is based on the estimation of the installation cost, the replacement cost, operation and maintenance cost, and so on in addition with high reliability to satisfy the load demand.

The optimization process is done after simulating the entire possible solutions of hybrid power system configurations. HOMER displays then a list of configurations sorted based on the Total Net Present Cost (TNPC) that can be used to compare different configurations from the lowest to the highest TNPC.

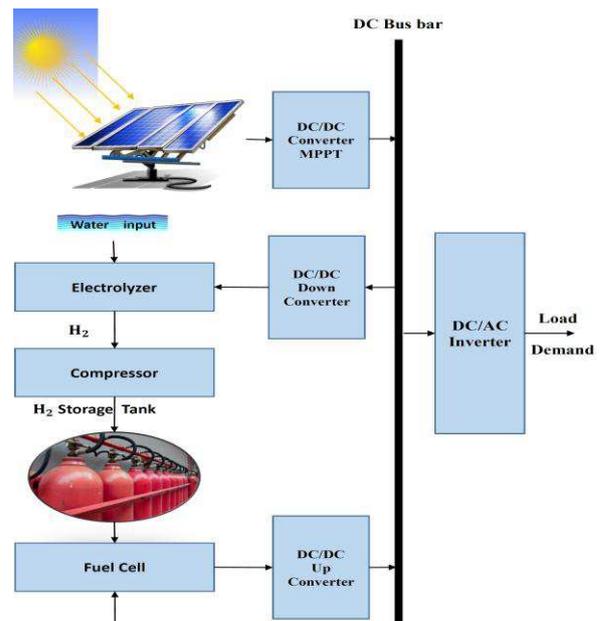


Fig. 3. Schematic of the proposed PV/FC hybrid system.

However, TNPC-based system configuration depends on the sensitivity variables (i.e. system constraints, component prices) chosen by the designer. The optimization process is in this context repeated for every sensitivity variables selection.

III. System Description

The hybrid power system design depends on some important sensitivity variables to optimize the system cost and the component sizes. Hence, before designing the system model, parameters like solar irradiation, location, and load demand have to be evaluated.

III.1. Case Study

The proposed hybrid power system for the city of Brest is tested using a practical load demand profile with real weather data: The latitude and longitude for location (48,45° N latitude, -4,42° E longitude). The project estimated lifetime is about 25 years while the annual interest rate is fixed to 6%.

III.2. Electrical Load Profile

The city of Brest load demand is illustrated by Figs. 4 and 5. The city load has been scaled to 16000 kWh/day. Seasons scale peak load is taken as 2MW. It should be noted that the 2MW annual peak load occurs in January. The largest demand occurs during the peak season (between December and January) and the lowest demand happens during the low season (between July and September).

For the city of Brest, solar radiation data were obtained from the NASA Atmospheric Data Center [25]. Figure 6 depicts the solar radiation profile over a one-year period. The annual average solar radiation for this area is about 3.39 kWh/m²/day.

III.3. Solar Resource and PV Generator Data

Regarding the PV generator, the array slope angle is set to 49° and the array azimuth is 0° which is referring to the south direction. The lifetime for this PV array system is 25 years with a de-rating factor of 70% and a ground reflectance is 20%.

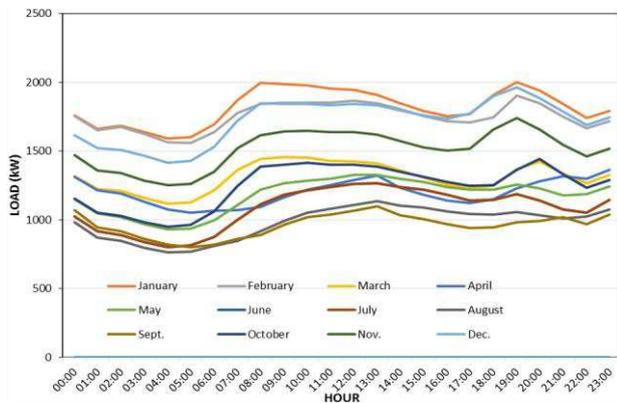


Fig. 4. Hourly average load variations in a year for all months.

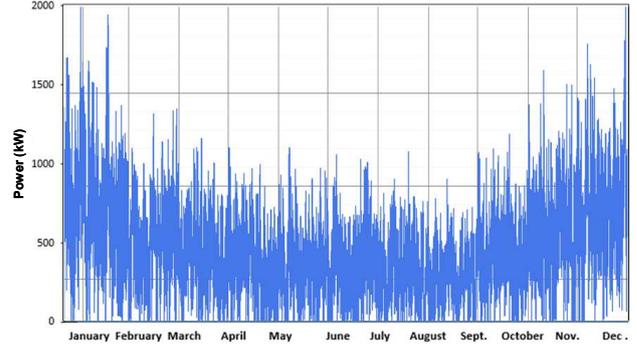


Fig. 5. Daily average load for a complete year.

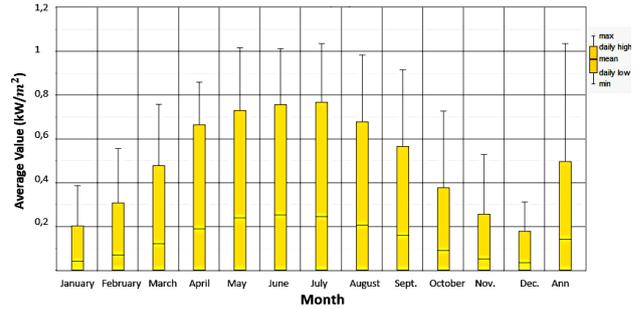


Fig. 6. Monthly average daily solar radiation.

The PV plant effect of temperature is considered. The clearness index and average the solar radiation are given in Table 1.

Table 1. Clearness Index and Average Solar Radiation.

Month	Clearness index	Average radiation (kWh/m ² /day)
Jan.	0.332	0.950
Feb.	0.378	1.630
March	0.443	2.890
April	0.509	4.550
May	0.532	5.730
June	0.522	6.040
July	0.525	5.850
Aug.	0.516	4.960
Sept.	0.518	3.800
Oct.	0.433	2.150
Nov.	0.390	1.240
Dec.	0.331	0.810

IV. Hybrid System Modeling and Operational Control Strategy

IV.1. Hybrid System Modeling

Even if the city of Brest receives a small amount of solar radiation throughout the year as shown by Fig. 6, this is enough to generate electric power. A hybrid power system that consists of a PV generator with an FC system fed by hydrogen is therefore a feasible solution. In addition, it should be noted that FCs with hydrogen tank are used in off-grid hybrid power systems.

Figure 7 shows the HOMER model of the studied PV/FC hybrid power system.

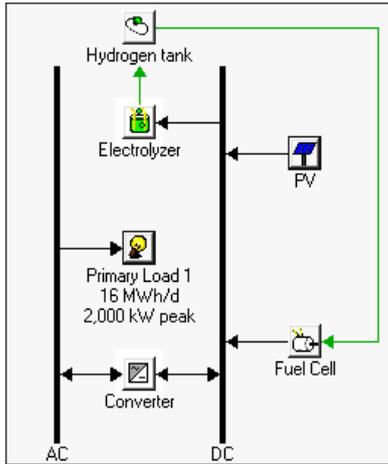


Fig. 7. PV-FC hybrid power system.

The optimization process consists in determining the optimal value of a so-called decision variable chosen by the designer and over which he has optimal control and for which HOMER can consider multiple possible values in its optimization process. In this study, decision variables include:

- The PV array size;
- The FC size;
- The DC/AC converter size;
- The electrolyzer and hydrogen storage tank sizes.

The annual electrical load must be met by the hybrid power system with a 100% rate. The considered annual real interest rate is 0.2%. The real interest rate is equal to the nominal interest rate minus the inflation rate. The project lifetime is 25 years.

The model constraints include:

- Maximum annual capacity shortage is 0%;
- Operating reserve is considered to be 10% of the hourly load.

HOMER input data are given by Tables 2 and 3 [26-28].

IV.2. Operational Control Strategy

The operational control strategy (power management) is summarized by the following steps:

- In normal operation, the PV generator supplies the load demand. The power excess will be used to feed the electrolyzer for hydrogen production and storage in the tank. If the hydrogen tank is full, the power will be diverted to a dump load.

Table 2. Input Data on Option Costs.

Options	Capital cost	Replacement cost	O&M cost
PV	50,000 \$/100kW	50,000 \$	5 \$/yr
Fuel Cell	3,000 \$/5kW	2,500 \$	0.08 \$/h/kW
Converter	2,000 \$/50kW	200 \$	100 O&M \$/yr
Electrolyzer	1,000 \$/10kW	100 \$	10 \$/yr
Hydrogen	1,000 \$/2,000kg	100 \$	10 \$/yr

Table 3. Input Data on Option Sizing and Other Parameters.

Options	Options on size and unit numbers	Life	Other information
PV	0, 3,000, 4,200, 4,300, 4,500, 5,000, 6,000, 8,000kW	25 yrs	De-rating factor 75%
Fuel Cell	0, 2,000, 2,100, 2,200 kW	40,000 hrs	Min. load ratio 1%
Converter	0, 2,000, 2,050, 2,100kW	20yrs	Inverter efficiency 95%
Electrolyzer	0, 3,400, 3,500, 3,600, 3,700kW	15yrs	Efficiency 80%
Hydrogen	0, 955,000, 955,500, 955,600, 956,000 kg	20 yrs	Initial tank level 10%

- If the PV generator power is less than the load demand, FCs will generate the remaining power to supply the load demand. FCs should fully supply the load demand in case of no radiation.

V. Optimization Results

The HOMER-based optimization of the PV/FC hybrid system using the TNPC is summarized by Table 4. The achieved configuration should supply power to the city of Brest and is able of meeting its load demand continuously throughout the year.

The optimal configuration is found after carrying-out several simulations with a 3.39 kWh/m²/day solar radiation and an annual average clearness index of 0.452, and considering different PV, FC, electrolyzer, hydrogen tank, and converter capacities: The PV capacity has been allowed to vary from 0 to 8000kW, the FC power has been considered to change from 0 to 2200kW, the electrolyzer and the converter capacities have been allowed to vary from 0 to 2200kW, the hydrogen storage capacity has been allowed up to 956000kg. In this context, a load-following control strategy was used.

The achieved hybrid power system TNPC is 8,942,636\$ while its CC and COE are 4,197,750\$, 0.120 \$/kWh, respectively for one year. Figure 8, Tables 5 and 6 summarize the proposed power system different costs. In terms of power, Fig. 9 shows the monthly average power production of each renewable source.

Table 4. Optimization Results of the Hybrid PV-FC Model.

PV (kW)	4200
FC (kW)	2000
Converter (kW)	2000
Electrolyzer (kW)	3400
Hydrogen tank (kg)	955000
Initial Capital Cost (\$)	4,197,750
TNPC (\$)	8,942,636
COE (\$/kWh)	0.120
Operating cost (\$/yr)	371,177

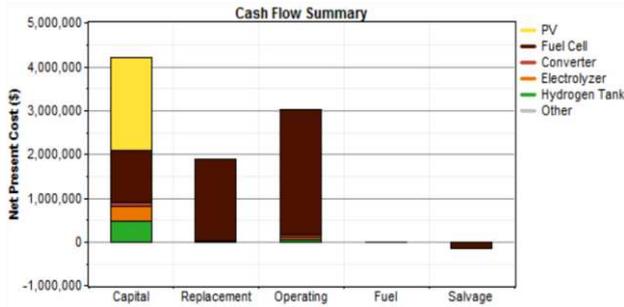


Fig. 8. Cost summary of the PV/FC hybrid system.

Table 5. Net Present Costs of the Hybrid System.

Comp.	Capital (\$)	Replace. (\$)	O&M (\$)	Salvage (\$)	Total (\$)
PV	2,100,000	0	2,685	0	2,102,685
Fuel Cell	1,200,000	1,859,515	2,856,111	-148,241	5,767,379
Converter	80,000	2,494	51,133	-1,398	132,230
Electrol.	340,000	14,187	43,463	-2,641	395,010
H2 Tank	477,500	14,889	61,041	-8,344	545,085
Other	250	0	0	0	250
System	4,197,750	1,891,085	3,014,431	-160,622	8,942,644

Table 6. Annualized Costs of the Hybrid System.

Component	Capital (\$/yr)	Replace. (\$/yr)	O&M (\$/yr)	Salvage (\$/yr)	Total (\$/yr)
PV	164,276	0	210	0	164,486
Fuel Cell	93,872	145,464	223,424	-11,597	451,163
Converter	6,258	195	4,000	-109	10,344
Electrol.	26,597	1,110	3,400	-207	30,900
H2 Tank	37,353	1,165	4,775	-653	42,640
Other	20	0	0	0	20
System	328,376	147,933	235,809	-12,565	699,553

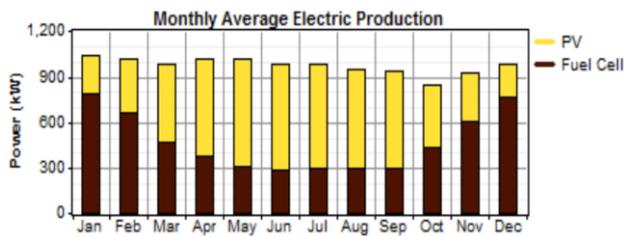


Fig. 9. Monthly average electric production.

In addition, Tables 7 and 8 give the annual electric energy production and consumption, respectively. In addition, Table 9 gives the hybrid power system annual emissions.

Finally, Figs. 10 and 11, which show the annual operation output of the PV and the FC generator, respectively, are given to illustrate the operational control strategy according to the city of Brest load demand and weather data.

Table 7. Annual Electric Energy Production of the Hybrid System.

Component	Production(kWh/yr)	Fraction
PV array	4,442,947	52%
Fuel Cell	4,070,915	48%
Total	8,513,862	100%

Table 8. Annual Electric Energy Consumption.

Load	Consumption (kWh/yr)	Fraction
AC primary load	5,839,835	71%
Electrolyzer load	2,366,666	29%
Total	8,206,500	100%

Table 9. Annual Emissions of the Hybrid System.

Pollutant	Emissions (kg/yr)
Carbon dioxide	-1,390
Carbon monoxide	885
Unburned hydrocarbons	98
Particulate matter	66.7
Sulfur dioxide	0
Nitrogen oxides	7,893

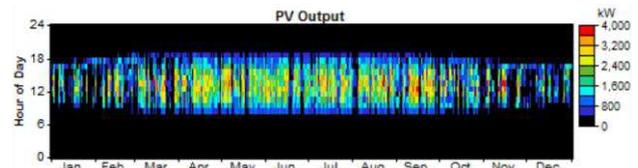


Fig. 10. Annual PV generator operation.

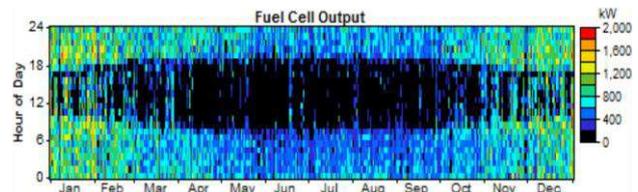


Fig. 11. Annual fuel cell generator operation.

VI. Conclusion

This paper dealt with the optimal design of a stand-alone hybrid PV/FC power system without battery storage to supply the electric load demand of the city of Brest, Western Brittany in France. The proposed optimal design study was focused on economical performance and was mainly based on the loss of the power supply probability concept.

The HOMER-based optimization study using the total net present cost has clearly shown that the proposed hybrid power system and in particular fuel cells are a viable alternative to diesel generators as a non-polluting reliable energy source with a reduced total cost of maintenance. It has also been shown that a fuel cell generator could efficiently complement a fluctuating renewable source as solar energy to satisfy growing loads.

References

- [1] O.H. Mohammed, Y. Amirat, M.E.H. Benbouzid and T. Tang, "Hybrid generation systems planning expansion forecast: A critical state of the art review", in *Proceeding of the 2013 IEEE IECON*, Vienna (Austria), pp.1666-1671, November 2013.
- [2] O.H. Mohammed, Y. Amirat, M.E.H. Benbouzid and Adel A. Elbaset, "Optimal design of a PV/fuel cell hybrid power system for the city of Brest in France," in *Proceedings of the 2014 IEEE ICGE*, Sfax (Tunisia) pp. 1-5, March 2014.
- [3] E.Y. Ulu, E. Cetin, O.O. Karakilinc, A. Yilanci and H.K. Ozturk, "Analysis of a photovoltaic-fuel cell hybrid energy system in terms of electromagnetic pollution," *International Journal on Energy Conversion*, vol. 1, n°1, pp. 14-22, January 2013.
- [4] F.H. Abanda, J.H.M. Tah, D. Duce, "PV-TONS: A photovoltaic technology ontology system for the design of PV-systems," *Engineering Applications of Artificial Intelligence*, vol. 26, n°4, pp. 1399-1412, April 2013.
- [5] YH. Liu, C.L. Liu, J.W. Huang and J.H. Chen, "Neural-network-based maximum power point tracking methods for photovoltaic systems operating under fast changing environments," *Solar Energy*, vol. 89, pp. 42-53, March 2013.
- [6] K. Himour, K. Ghedamsi and E.M. Berkouk, "Supervision and control of grid connected PV-Storage systems with the five level diode clamped inverter," *Energy Conversion and Management*, vol. 77, pp. 98-107, January 2014.
- [7] S. Lizin, S.V. Passel, E. De Schepper and L. Vranken, "The future of organic photovoltaic solar cells as a direct power source for consumer electronics," *Solar Energy Materials and Solar Cells*, vol. 103, pp. 1-10, August 2012.
- [8] S. Semaoui, A.H. Arab, S. Bacha and B. Azoui, "Optimal sizing of a stand-alone photovoltaic system with energy management in isolated areas," *Energy Procedia*, vol. 36, 358-368, 2013.
- [9] Y. Ru, J. Kleissl and S. Martinez, "Exact sizing of battery capacity for photovoltaic systems," *European Journal of Control*, September 2013.
- [10] S. Semaoui, A. Hadj Arab, S. Bacha and B. Azoui, "The new strategy of energy management for a photovoltaic system without extra intended for remote-housing," *Solar Energy*, vol. 94, pp. 71-85, August 2013.
- [11] J. Li, Y. Chen and Y. Liu, "Research on a stand-alone photovoltaic system with a supercapacitor as the energy storage device," *Energy Procedia*, vol. 16, Part C, pp. 1693-1700, 2012.
- [12] M.E. Glavin, P.K.W. Chan, S. Armstrong and W.G. Hurley, "A stand-alone photovoltaic supercapacitor battery hybrid energy storage system," in *Proceedings of the 2008 EPE-PEMC*, Poznan (Poland), pp. 16_-1695, September 2008.
- [13] A. Hiendro, R. Kurnianto, M. Rajagukguk, Y.M. Simanjuntak, Junaidi, "Techno-economic analysis of photovoltaic/wind hybrid system for onshore/remote area in Indonesia," *Energy*, vol. 59, pp. 652-657, September 2013.
- [14] E. Kabalci, "Design and analysis of a hybrid renewable energy plant with solar and wind power," *Energy Conversion and Management*, vol. 72, pp. 51-59, August 2013.
- [15] G. Merei, C. Berger and D.U. Sauer, "Optimization of an off-grid hybrid PV-Wind-Diesel system with different battery technologies using genetic algorithm," *Solar Energy*, vol. 97, pp. 460-473, November 2013.
- [16] A. Colantoni, E. Allegrini, K. Boubaker, L. Longo, S. Di Giacinto and P. Biondi, "New insights for renewable energy hybrid photovoltaic/wind installations in Tunisia through a mathematical model," *Energy Conversion and Management*, vol. 75, pp. 398-401, November 2013.
- [17] R. Kumar, R.A. Gupta and A.K. Bansal, "Economic analysis and power management of a stand-alone wind/photovoltaic hybrid energy system using biogeography based optimization algorithm," *Swarm and Evolutionary Computation*, vol. 8, pp. 33-43, February 2013.
- [18] R. Boudries, "Analysis of solar hydrogen production in Algeria: Case of an electrolyzer-concentrating photovoltaic system," *International Journal of Hydrogen Energy*, vol. 38, n°26, pp. 11507-11518, August 2013.
- [19] D. Rekioua, S. Bensmail and N. Bettar, "Development of hybrid photovoltaic-fuel cell system for stand-alone application," *International Journal of Hydrogen Energy*, vol. 39, n°3, pp. 1604-1611, January 2014.
- [20] A.U. Chàvez-Ramirez, V. Vallejo-Becerra, J.C. Cruz, R. Ornelas, G. Orozco, R. Munoz-Guerrero and L.G. Arriaga, "A hybrid power plant (Solar-Wind-Hydrogen) model based in artificial intelligence for a remote-housing application in Mexico," *International Journal of Hydrogen Energy*, vol. 38, n°6, pp. 2641-2655, February 2013.
- [21] S.H. Gilani, M.J. Ghadi and H. Afrakhte, "Optimal allocation of wind turbines considering different costs for interruption aiming at power loss reduction and reliability improvement using imperialistic competitive algorithm," *International Review of Electrical Engineering*, vol. 8, n°1, pp. 284-296, February 2013.
- [22] M. Castaneda, A. Cano, F. Jurado, H. Sánchez and L.M. Fernandez, "Sizing optimization, dynamic modeling and energy management strategies of a stand-alone PV/hydrogen/battery-based hybrid system," *International Journal of Hydrogen Energy*, vol. 38, n°10, pp. 3830-3845, April 2013.
- [23] B. Panahandeh, J. Bard, A. Outzourhit and D. Zejli, "Simulation of PV-wind-hybrid systems combined with hydrogen storage for rural electrification," *International Journal of Hydrogen Energy*, vol. 36, n° 6, pp. 4185-4197, March 2011.
- [24] <http://homerenergy.com/>
- [25] <https://eosweb.larc.nasa.gov/sse/>
- [26] M. Beccali, S. Brunone, M. Cellura and V. Franzitta, "Energy, economic and environmental analysis of RET-hydrogen systems in residential buildings," *Renewable Energy*, vol. 33, n°3, pp. 366-382, March 2008.
- [27] S.B. Silva, M.A.G. de Oliveira, M.M. Severino, Economic evaluation and optimization of a photovoltaic-fuel cell-batteries hybrid system for use in the Brazilian Amazon," *Energy Policy*, vol. 38, n°11, pp. 6713-6723, November 2010.
- [28] K. Karakoulidis, K. Mavridis, D.V. Bandekas, P. Adoniadis, C. Potolias and N. Vordos, "Techno-economic analysis of a stand-alone hybrid photovoltaic-diesel-battery-fuel cell power system," *Renewable Energy*, vol. 36, n°8, pp. 2238-2244, August 2011.

¹University of Brest, EA 4325 LBMS, Rue de Kergoat, CS 93837, 29238 Brest Cedex 03, France (e-mail: Mohamed.Benbouzid@univ-brest.fr).

²ISEN-Brest, 20, EA 4325 LBMS, Rue Cuirassé Bretagne, CS 42807, 29228 Brest Cedex 2, France. (e-mail: Yassine.Amirat@isen.fr).

³Shanghai Maritime University, Department of Electrical Automation, 201306 Shanghai, China.

⁴University of Minia, Electrical Engineering Department, Minia, Egypt.



Omar Hazem Mohammed was born in Mosul, Iraq, in 1974. He received the B.Sc. and M.Sc. degrees both in electrical engineering, from the University of Technology of Baghdad, Baghdad, Iraq, in 1996 and 2004 respectively. After graduation, he joined the Technical College of Mosul, University of Technology of Baghdad, Mosul, Iraq, as an Assistant Lecturer.

He is currently working toward the Ph.D. degree on optimal sizing of hybrid energy system with high renewables penetration at

the University of Brest, Brest, France.



Yassine Amirat was born in Annaba, Algeria, in 1970. He received the B.Sc. and M.Sc. degrees both in electrical engineering, from the University of Annaba, Annaba, Algeria, in 1994 and 1997 respectively. In 2011, he received the PhD degree in electrical engineering from the University of Brest, Brest, France.

Dr. Amirat was a Lecturer in the University of Annaba, Annaba, Algeria, and then in the Institut Supérieur de l'Electronique et du Numérique (ISEN), Brest, France. Since January 2012, he is an Associate Professor of

electrical engineering. His current research interests are the condition monitoring and the control of electrical drives and power electronics.



Mohamed El Hachemi Benbouzid was born in Batna, Algeria, in 1968. He received the B.Sc. degree in electrical engineering from the University of Batna, Batna, Algeria, in 1990, the M.Sc. and Ph.D. degrees in electrical and computer engineering from the National Polytechnic Institute of Grenoble, Grenoble, France, in 1991 and 1994, respectively, and the Habilitation à Diriger des Recherches degree from the University of Picardie “Jules Verne,” Amiens, France, in 2000.

After receiving the Ph.D. degree, he joined the Professional Institute of Amiens, University of Picardie “Jules Verne,” where he was an Associate Professor of electrical and computer engineering. Since September 2004, he has been with the Institut Universitaire de Technologie de Brest, University of Brest, Brest, France, where he is a Professor of electrical engineering. His main research interests and experience include analysis, design, and control of electric machines, variable-speed drives for traction, propulsion, and renewable energy applications, and fault diagnosis of electric machines.

Prof. Benbouzid is an IEEE Senior Member. He is the Editor-in-Chief of the International Journal on Energy Conversion (IRECON). He is also an Associate Editor of the IEEE TRANSACTIONS ON ENERGY CONVERSION, the IEEE TRANSACTIONS ON INDUSTRIAL ELECTRONICS, the IEEE TRANSACTIONS ON SUSTAINABLE ENERGY, and the IEEE TRANSACTIONS ON VEHICULAR TECHNOLOGY. He was an Associate Editor of the IEEE/ASME TRANSACTIONS ON MECHATRONICS from 2006 to 2009.



Gilles Feld was born in Paris, France, in 1954. He was a Professeur Agrégé at the Electrical Engineering Department of Ecole Normale Supérieure de Cachan, Cachan, France, from 1998 to 2013. He was also a researcher at the Mechatronics Department of the ESTACA, Laval, France, from 2005 to 2013.

He is now a Professeur Agrégé at ISEN, Brest, France and a researcher at the LBMS_Lab. His main research interests are in electric machines, drives, and power

electronics design and control.



Tianhao Tang was born in Jiangsu, China, in 1955. He received the B.Sc. and the M.Sc. degrees in electrical engineering from the Shanghai University of Technology, Shanghai, China, in 1982 and 1987 respectively, the Ph.D. degree in control engineering from the Shanghai University, Shanghai, China in 1998.

From 1988 to 1991 he was a Lecturer at the Shanghai Maritime University Shanghai, China, where he became an Associate Professor and a Professor in 1992 and 1998 respectively. He is currently the Director of the Department of Electric Drives and Control Systems in the Shanghai Maritime University, Shanghai, China, and the vice-Director of the Sino-French Joint Research Institute of Galileo & Maritime ITS for Safer Seas. His main research interests are intelligent control, electrical propulsion systems and power electronics in renewable applications.



Adel A. Elbaset Mohammed was born in Nag Hamadi, Qena, Egypt, in 1971. He received the B.Sc., M.Sc., and Ph.D. from the University of Minia, Minia, Egypt, in 1995, 2000 and 2006, respectively.

Dr. Elbaset is an Associate Professor in the Electrical Engineering Department, University of Minia, Minia, Egypt since 1996. His research interests are in the area of renewable energy system, power electronics, power system protection and control, power quality and harmonics, neural network, and fuzzy

systems.