

A Generalized Geometric Programming Sub-problem of Transformer Design Optimization

Tamás Orosz, Tamás Nagy, Zoltán Tamus

► **To cite this version:**

Tamás Orosz, Tamás Nagy, Zoltán Tamus. A Generalized Geometric Programming Sub-problem of Transformer Design Optimization. 8th Doctoral Conference on Computing, Electrical and Industrial Systems (DoCEIS), May 2017, Costa de Caparica, Portugal. pp.373-381, 10.1007/978-3-319-56077-9_36 . hal-01629558

HAL Id: hal-01629558

<https://hal.inria.fr/hal-01629558>

Submitted on 6 Nov 2017

HAL is a multi-disciplinary open access archive for the deposit and dissemination of scientific research documents, whether they are published or not. The documents may come from teaching and research institutions in France or abroad, or from public or private research centers.

L'archive ouverte pluridisciplinaire **HAL**, est destinée au dépôt et à la diffusion de documents scientifiques de niveau recherche, publiés ou non, émanant des établissements d'enseignement et de recherche français ou étrangers, des laboratoires publics ou privés.



A Generalized Geometric Programming Sub-problem of Transformer Design Optimization

Tamás Orosz^{1,2}, Tamás Nagy² and Tamás Zoltán Ádám¹

¹ Budapest University of Technology and Economics, Budapest, Hungary,

² Robert Bosch kft, Budapest, Hungary,
orosz.tamas@vet.bme.hu

Abstract. The first step in transformer design optimization is to solve a non-linear optimization task. Here, not only the physical and technological requirements, but the economic aspects are also considered. Large number of optimization algorithms have been developed to solve this task. These methods result the optimal electrical parameters and the shape of the core and winding geometry. Most of them model the windings by their copper filling factors. Therefore the transformer designer's next task, to find out the detailed winding arrangement, which fits to the optimization results. However, in the case of large power transformers, the calculation of some parameters like: winding gradients, short-circuit stresses etc., needs the knowledge of the exact wire dimensions and winding arrangement. Therefore, an other optimization task should be solved. This paper shows how this sub-problem can be formulated and solved as a generalized geometric program.

Keywords: Mathematical Programming, Geometric Programming, Transformer Optimization, Electrical Machine Design

1 Introduction

It is well known that the transformer design optimization is a complex, nonlinear optimization task, due to the nature of the interaction of several physical fields encountered during the design of an electrical machine. [1]. Therefore, in practice, this design process is split into more sub-optimization tasks and design stages. The first design stage is the preliminary or tendering design stage, where not only the physical and technological requirements, but the economical aspects are also considered [2]. Large number of optimization algorithms have been published in the literature to solve this task. [3] These methods are using simplified transformer models to calculate the optimal electrical parameters and the shape of the core and windings with adequate precision in a very short time. These approaches generally model the windings by a copper filling factor to obtain the optimal key design parameters. This simplification is widely used in the industry, and gives accurate results for the electrical parameters [4]. Moreover, FEM calculations also use this replacement [5].

In the case of large power transformers, the calculation of some parameters like winding gradients, short-circuit stresses etc., requires deeper knowledge of the exact

wire dimensions and winding arrangement. Therefore, the transformer designer's next task is to find out the detailed winding arrangement which fits the optimized winding shape and their electrical parameters. This is another optimization task that should be performed Fig.1. This design stage is often time consuming and usually needs huge expertise and manual interaction from the designer.

This paper demonstrates how this design step can be solved with introducing a novel sub-problem. This sub-problem assumes that the geometrical and electrical parameters of the winding are known from a copper filling factor based transformer optimization. Its application is demonstrated on a case-type winding. It can be generalized for every other type of windings and it can be integrated into the metaheuristic based solution to replace copper filling factor based approximation [6]. A generalized geometric programming can be formulated and solved, which guarantees that the global optimum is found in no time. [7]

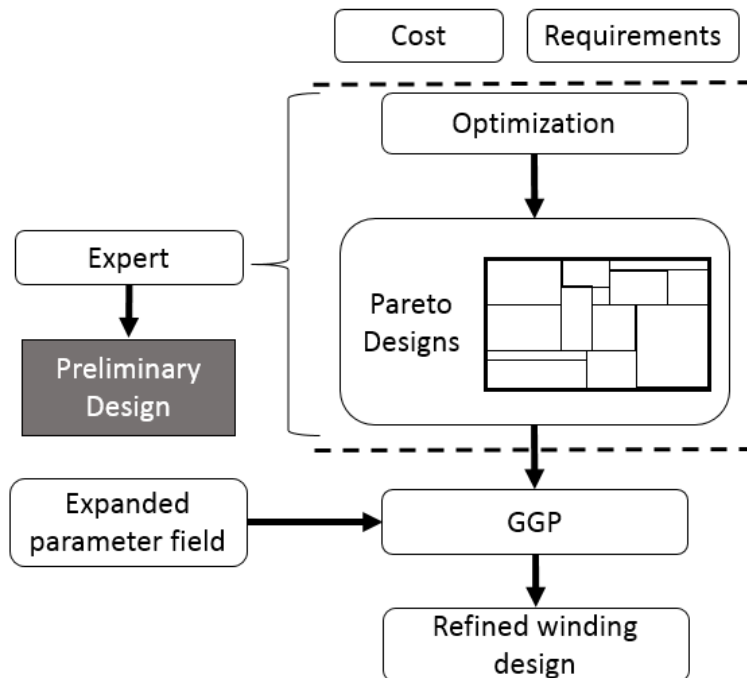


Fig. 1. The place of the generalized geometric programming sub-problem in electric machine design process.

2 Relationship to Smart Systems

The smart system environments will arise new challenges regarding to total cost of ownership, which is the base of the hereby presented optimization process. "The increasing proliferation of renewable energy resources and new size-able loads like

electric vehicle (EV) charging stations has posed many technical and operational challenges to distribution grids." [8] Therefore the conventional passive system design have to be replaced by an active concept resulting in a change of the emphasis of cost efficient design.

3 Generalized Geometric Programming

A geometric program is a type of the non-linear mathematical optimization problem characterized by the objective and constraint functions given in the following special form [7, 9]:

$$\begin{aligned} & \min f_0(x) \\ \text{s.t. } & f_i(x) \leq 1, \quad i = 1, \dots, m \\ & g_j(x) = 1, \quad j = 1, \dots, n, \end{aligned} \tag{1}$$

where $x = (x_1, x_2, \dots, x_n)$ is a vector containing the optimization variables, f_0, \dots, f_m are the posynomial functions, and g_1, \dots, g_n are the monomial functions. All the elements of x must be positive. The monomial function $g(x)$ can be expressed as

$$g_j(x) = c_g \cdot x_1^{\alpha_1} \cdot x_2^{\alpha_2} \cdot \dots \cdot x_n^{\alpha_n}, \tag{2}$$

where $c_g \in \mathbb{R}$, $\alpha_i \in \mathbb{R}$, and $c_g > 0$. This definition of monomial term is similar, but differs from the standard definition of the monomial used in algebra, where the exponents must be non-negative integers and the coefficient c is 1.

The posynomial function is the linear combination of monomials

$$f_i(x) = \sum_{k=1}^K c_k \cdot x_1^{\alpha_{1k}} \cdot x_2^{\alpha_{2k}} \cdot \dots \cdot x_n^{\alpha_{nk}}. \tag{3}$$

We can introduce the generalized posynomials such that a function f of positive variables x_1, \dots, x_n is a generalized posynomial if it can be formed from posynomials using the operations of addition, multiplication, positive (fractional) power, and maximum.

Geometric programming (GP) problems, in general, are not convex optimization problems, and the main trick in the solution of a GP is a transformation to a convex optimization task. This transformation, which is a simple logarithmic change in the variables, is automatically performed by the solver. The GP modeler only knows the formal rules defined in 1.

There are many major advantages of GP modeling. First, the GP formalism guarantees that the solver finds the globally optimal solution, and if the problem is infeasible, this provides that no feasible point exists. Second, the major advantage of this formulation is the great efficiency of this special class of optimization problems. Finally, these interior-pointbased GP solvers are also very robust [6, 7, 9].

4 The Optimization Sub-process

4.1 Input Parameters

The main purpose of the optimization sub-process is to determine additional input parameters for the preliminary design optimization. These methods, which employ copper filling factors, are suitable to determine the leakage magnetic field distribution inside the core working window. Even a finite element method is also applicable for greater accuracy [5]. This calculation yields the maximum value of the radial and axial magnetic flux inside the winding area. These important parameters will be our additional input parameter next to the winding dimensions. Then we can prescribe an optimization problem that minimizes the load loss in the desired winding area. In our example we focus on disc type winding arrangement consisting of single conductors.

The following input values are taken from the previous sub-optimization process:

- t_w radial thickness of the winding,
- h_w axial height of the winding,
- r_m mean radius of the winding,
- n number of turns,
- B_{rad} radial flux density,
- B_{ax} axial flux density,
- ff copper filling factor.

The input parameters taken from the requirement specification:

- f frequency,
- I phase current,
- $trad$ minimum value of radial insulation thickness,
- tax minimum value of axial insulation thickness.
- The goal of the main optimization process is to obtain the following values:
- nax axial number of turns,
- $nrad$ radial number of turns,
- nc number of conductors in a turn,
- Acu copper area in a turn,
- Vcu copper volume,
- w width of a conductor,
- h height of a conductor.

The optimization algorithm requires support parameters describing the physical constraints:

- $P0$ heat flow density,
- ρ specific resistance,
- α ratio of total and exposed surface area,
- kc heat conductivity of the insulation paper,
- P_{loss} total load loss,
- β_{hor}, β_{ver} horizontal, vertical heat flow ratio;

- θ_{shor} , θ_{sver} horizontal, vertical temperature rise above cooling oil,
- θ_{phor} , θ_{pver} vertical temperature rise above cooling oil.

4.2 Winding Geometry

The following posynomial inequality and monomial constraints describe the winding arrangement, this is a disc winding with normal conductors in the examined case:

$$n = n_{ax} \cdot n_{rad}, \quad n_{ax} \cdot h + n_{ax} \cdot t_{ax} \leq h_w \quad (4)$$

$$t_{hor} \cdot n_c \cdot n_{rad} + w \cdot n_c \cdot n_{rad} \leq t_w, \quad A_{cu} = n_{rad} \cdot n_c \cdot w \cdot h \quad (5)$$

$$V_{cu} = 2 \cdot \pi \cdot r_m \cdot n \cdot A_{cu}, \quad f \cdot f \leq \frac{n \cdot A_{cu}}{h_w \cdot t_w} \quad (6)$$

$$w \leq w_{max}, \quad h \leq h_{max} \quad (7)$$

$$n_c \leq 1, \quad n_{rad} \leq 1. \quad (8)$$

4.3 Loss Calculations

The Ploss is minimized in this optimization task, which consist of the ohmic losses and the eddy losses. The eddy loss calculation takes into account the axial and radial components of the magnetic flux. It is assumed that the magnetic field is not modified by the field of the eddy currents [5]:

$$P_{loss} = p_{dc} + p_{ax} + p_{rad}, \quad p_{dc} = \rho \cdot \frac{2 \cdot \pi \cdot r_m}{A_{Cu}} \cdot I^2 \quad (9)$$

$$p_{ax} = \frac{1}{24\rho} \cdot 2 \cdot \pi \cdot f \cdot w \cdot B_{ax}, \quad p_{rad} = \frac{1}{24\rho} \cdot 2 \cdot \pi \cdot f \cdot h \cdot B_{rad} \quad (10)$$

4.4 Thermal Model

The applied calculation method of the temperature gradient uses an electrical analogy of heat-exchange, to solve the 2D-Poisson equation of the steady-state heat-flow [10]. It implies the decomposition of the whole winding into simplified components (cooling blocks), where the heat ow possible only in the axial or the radial directions (Fig. 2) [11, 13]. Here, the axial and the radial component of the heat-flow density is owing through the effective thermal resistance of the insulation and the oil boundary layer (Fig. 2). The heat-flow density value defined by the following monomial expression:

$$P_o = \frac{P_{loss}}{N_{ax} \cdot 2 \cdot \pi \cdot r_m} \quad (11)$$

The effective insulation thickness in the axial (vertical) and the radial direction are the following:

$$t_{ver} = t_c, \quad t_{hor} = \frac{\alpha}{3} \cdot (n_{rad} \cdot n_c \cdot t_c) \quad (12)$$

To calculate the ratio of the radial and axial heat-flow density, between the cooling surfaces the loss ratio parameters are introduced by [11] (β parameters). However, the calculation method of these parameters, which presented in [11] not fulfills the GGP formalism. Therefore a monomial function is fitted in β_{hor} and β_{ver} (Fig. 3). Using this formulation, the horizontal and vertical heat-flows and the temperature gradients through the insulation can be formulated by the following monomial expressions:

$$p_{hor} = 0.5 \cdot \frac{p_0 \cdot \beta_{hor}}{\alpha \cdot w_t}, \quad p_{ver} = 0.5 \cdot \frac{p_0 \cdot \beta_{ver}}{\alpha \cdot h} \quad (13)$$

$$\theta_{p,hor} = \left(\frac{t_C}{2 \cdot k_C} \right) \cdot p_{hor}, \quad \theta_{p,ver} = \left(\frac{\alpha \cdot N_{rad} \cdot N_C \cdot t_C}{2 \cdot k_C} \right) \cdot \frac{p_{ver}}{3} \quad (14)$$

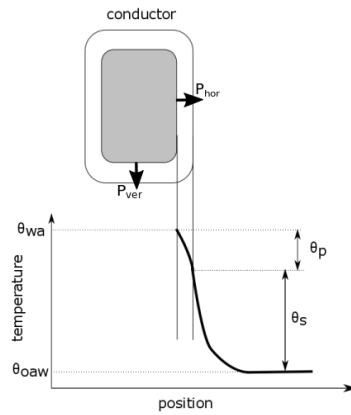


Fig. 2. Temperature notations around the winding-oil contact at approximately the half of winding height

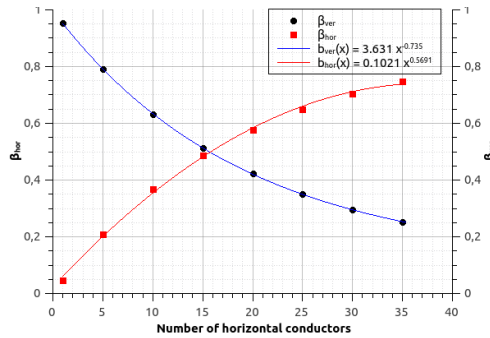


Fig. 3. Posynomial form function for the horizontal and the vertical heat ow ratio calculation.

Temperature gradient through the oil boundary layer, in the case of ON or OF cooling:

$$\theta_s = C \cdot a \cdot \sqrt{p_{hor}}, \quad \theta_s = C \cdot \sqrt{p_{ver}} \quad (15)$$

Where, the auxiliary parameter $a = 1$ in the case of zig-zag cooling. Regardless of the used formula, the incorporated constant C depends on the established cooling mechanism. Potential interpretations are shown in [11, 13].

The gradient is defined by the following generalized posynomial:

$$\min(\theta_{p,hor} + \theta_{s,hor}, \theta_{p,ver} + \theta_{s,ver}) \leq \theta \quad (16)$$

The $\min()$ function is not a valid generalized posynomial inequality, but it can be handled by a replacement [9].

5 Results

The winding sub-optimization method has been tested on an inner winding of a three-phase, 10 MVA, 33/6.9 kV, star/star Volts/turn=46.87, $Z=7.34\%$ transformer. The transformer data is presented in [14], and the optimization is based on this real life example transformer. This example gives us the following input parameters: $t_w=35$ mm, $h_w=1100$ mm, $n=89$, $r_m = 495/2$ mm, $I = 836$ A, $f = 50$ Hz. As we consider disc type winding, all oil cooling ducts are considered to be 3 mm wide. The minimal thickness of the insulation of the single conductor is 0.5 mm, this value was chosen taking into account of the voltage level. The transformer specification and relevant design details of the source [14] are:

- *LV conductor: thickness=2.3 mm, insulation between conductors=0.5 mm, area of one conductor=22:684 mm²*
- *Total conductor area=12 × area of one conductor=272:21 mm²*
- *LV winding volume for 3 phases =0.1079 m³*
- *Peddy = 489:55 W (only radial ux considered)*
- *Pdc = 21:885 kW*
- *copper filling factor 60%*
- *the winding temperature rise is undocumented*

After the optimization our results for this transformer are the following:

- *LV conductor: thickness=1.8 mm, insulation between conductors=0.5 mm, area of one conductor = 21.6 mm²*
- *Total conductor area=12 × area of one conductor=237:6 mm²*
- *LV winding volume for 3 phases =0.0986 m³*
- *Peddy = 850.27 W (includes the axial and radial ux too)*
- *Pdc = 21.6 kW*
- *copper filling factor 55%*
- *the winding temperature rise above oil is 14.1 K*

6 Conclusions

Finding a cost efficient transformer design is a complex, non-linear optimization task. Therefore, the transformer design process is separated into several, independent sub-

problems and design stages. This paper deals with the preliminary design stage, where numerous algorithms has been applied to find the key design parameters with minimal total owning cost. However, most of these methods are modeling the windings by their copper filling factors - a simplification widely used in the industry with good accuracy - this approach is not appropriate to take into account the numerous possible winding arrangement. The transformer optimization sub-problem is presented and solved in this paper, with the method of generalized geometric programming. The results are shown a good agreement with the realized transformer winding's parameters. The presented model can be generalized to any type of winding arrangements and various type of conductors, for example case of continuously transposed cables.

References

1. R. M. Del Vecchio, B. Poulin, P. T. Feghali, D. M. Shah, and R. Ahuja, Transformer design principles: with applications to core-form power transformers. CRC press, 2010.
2. T. Orosz, P. Sőrés, D. Raisz, and Á. Z. Tamus, "Analysis of the green power transition on optimal power transformer designs," *Periodica Polytechnica Electrical Engineering and Computer Science*, vol. 59, no. 3, pp. 125-131, 2015.
3. J. Olivares-Galvan, P. Georgilakis, I. Fofana, S. Magdaleno-Adame, E. Campero-Littlewood, and M. Esparza-Gonzalez, "A bibliographic analysis of transformer literature 2001-2010," in *Power Generation, Transmission, Distribution and Energy Conversion (MEDPOWER 2012)*, 8th Mediterranean Conference on. IET, 2012, pp. 1-6.
4. P. S. Georgilakis, *Spotlight on modern transformer design*. Springer Science & Business Media, 2009.
5. O. W. Andersen, "Transformer leakage flux program based on the finite element method", *IEEE Transactions on Power Apparatus and Systems*, vol. PAS-92, no. 2, pp. 682-689, March 1973.
6. T. Orosz, Á. Sleisz, and Z. Á. Tamus, "Metaheuristic optimization preliminary design process of core-form autotransformers", *IEEE Transactions on Magnetics*, vol. 52, no. 4, pp. 1-10, April 2016.
7. S. Boyd and L. Vandenberghe, *Convex optimization*. Cambridge university press, 2004.
8. M. Andresen, L. F. Costa, G. Buticchi, and M. Liserre, "Smart transformer reliability and efficiency through modularity," in *2016 IEEE 8th International Power Electronics and Motion Control Conference (IPEMC-ECCE Asia)*, May 2016, pp. 3241-3248.
9. S. Boyd, S.-J. Kim, L. Vandenberghe, and A. Hassibi, "A tutorial on geometric programming," *Optimization and engineering*, vol. 8, no. 1, pp. 67-127, 2007.
10. T. Orosz, G. Kleizer, T. Iváncsy, and Z. Á. Tamus, "Comparison of methods for calculation of core-form power transformer's core temperature rise," *Periodica Polytechnica Electrical Engineering and Computer Science*, vol. 60, no. 2, pp. 88-95, 2016.
11. D. L. Imre; Gy, "A method for determining the steady-state temperature distribution in the windings discs of oil-cooled transformers," *Periodica Polytechnica of Electrical Engineering*, vol. 20, no. 4, pp. 89-103, 1976.
12. H. M. Ryan, *High voltage engineering and testing*, 3rd Edition. IET, 2013, no. 32.
13. S. Ryder et al., "A simple method for calculating winding temperature gradient in power transformers," *Power Delivery*, *IEEE Transactions on*, vol. 17, no. 4, pp. 977-982, 2002.
14. S. V. Kulkarni and S. Khaparde, *Transformer engineering: design and practice*. CRC Press, 2004, vol. 25.